



भारतीय मानक ब्यूरो  
(उपभोक्ता मामले, खाद्य एवं सार्वजनिक वितरण मंत्रालय, भारत सरकार)  
**BUREAU OF INDIAN STANDARDS**  
(Ministry of Consumer Affairs, Food & Public Distribution, Govt. of India)

मानक भवन, 9, बहादुर शाह ज़फर मार्ग, नई दिल्ली - 110002  
Manak Bhawan, 9, Bahadur Shah Zafar Marg, New Delhi - 110002  
Phones: 23230131 / 2323375 / 23239402  
Website: [www.bis.gov.in](http://www.bis.gov.in), [www.manakonline.in](http://www.manakonline.in)

## व्यापक परिचालन मसौदा

हमारा संदर्भ : सीईडी 03/टी-92

18 मार्च 2024

तकनीकी समिति: स्वच्छता उपकरण एवं जल फिटिंग विषय समिति, सीईडी 03

प्राप्तकर्ता :

- सिविल अभियांत्रिकी विभाग परिषद, सीईडीसी के सभी सदस्य
- स्वच्छता उपकरण व सहायकांग की उपसमिति, सीईडी 3:1, घरेलू जल फिटिंग की उपसमिति, सीईडी 3:2, पानी के मीटर की उपसमिति, सीईडी 3:4 एवं वाल्व व गेट की उपसमिति, सीईडी 3:5 के सभी सदस्य।
- जल कुशल नल-साजी उत्पादों की आवश्यकताओं के लिए मानक तैयार करने के लिए पैनल, सीईडी 3:P1 के सभी सदस्य।
- रुचि रखने वाले अन्य निकाय।

महोदय/ महोदया,

निम्नलिखित मानक का मसौदा संलग्न है:

प्रलेख संख्या	शीर्षक
सीईडी 36(24991)WC	जलकल के लिये बॉल वाल्व — विशिष्टि का भारतीय मानक मसौदा (ICS: 91.140.60)

कृपया इस मसौदे का अवलोकन करें और अपनी सम्मतियाँ यह बताते हुए भेजे कि यह मसौदा प्रकाशित हो तो इन पर अमल करने में आपको व्यवसाय अथवा कारोबार में क्या कठिनाइयाँ आ सकती हैं।

**सम्मतियाँ भेजने की अंतिम तिथि: 18 अप्रैल 2024**

सम्मति यदि कोई हो तो कृपया अधोहस्ताक्षरी को ई-मेल द्वारा [ced003@bis.gov.in](mailto:ced003@bis.gov.in) पर या उपरलिखित पते पर, संलग्न फॉर्मेट में भेजें। सम्मतियाँ बीआईएस ई-गवर्नेंस पोर्टल, [www.manakonline.in](http://www.manakonline.in) के माध्यम से ऑनलाइन भी भेजी जा सकती हैं।

यदि कोई सम्मति प्राप्त नहीं होती है अथवा सम्मति में केवल भाषा संबंधी त्रुटि हुई तो उपरोक्त प्रलेख को यथावत अंतिम रूप दे दिया जाएगा। यदि सम्मति तकनीकी प्रकृति की हुई तो विषय समिति के अध्यक्ष के परामर्श से अथवा उनकी इच्छा पर आगे की कार्यवाही के लिए विषय समिति को भेजे जाने के बाद प्रलेख को अंतिम रूप दे दिया जाएगा।

यह प्रलेख भारतीय मानक ब्यूरो की वेबसाइट [www.bis.gov.in](http://www.bis.gov.in) पर भी उपलब्ध है।

धन्यवाद।

भवदीय

ह/-

द्वैपायन भद्र  
वैज्ञानिक ई एवं प्रमुख  
सिविल अभियांत्रिकी विभाग  
ई-मेल: [ced003@bis.gov.in](mailto:ced003@bis.gov.in)  
फोन: +91-11 2323 5529

संलग्न: उपरलिखित



भारतीय मानक ब्यूरो

(उपभोक्ता मामले, खाद्य एवं सार्वजनिक वितरण मंत्रालय, भारत सरकार)

BUREAU OF INDIAN STANDARDS

(Ministry of Consumer Affairs, Food & Public Distribution, Govt. of India)

मानक भवन, 9, बहादुर शाह ज़फ़र मार्ग, नई दिल्ली - 110002  
Manak Bhawan, 9, Bahadur Shah Zafar Marg, New Delhi - 110002  
Phones: 23230131 / 2323375 / 23239402  
Website: [www.bis.gov.in](http://www.bis.gov.in), [www.manakonline.in](http://www.manakonline.in)

## WIDE CIRCULATION DRAFT

Our Reference: CED 03/T-92

18 March 2024

**TECHNICAL COMMITTEE: SANITARY APPLIANCES AND WATER FITTINGS  
SECTIONAL COMMITTEE, CED 03**

**ADDRESSED TO:**

1. All Members of Civil Engineering Division Council, CEDC
2. All Members of Sanitary Appliances and Water Fittings Sectional Committee, CED 3
3. All Members of Sanitary Appliances and Accessories Sub-Committee, CED 3:1, Domestic Water Fittings Sub-Committee, CED 3:2, Water Meter Sub-Committee, 3:4 & Valves and Gates Sub-Committee, CED 3:5
4. All Members of Panel for Formulation of Standards for Requirements for Water Efficient Plumbing Products, CED 3:P1
5. All others interested.

Dear Sir/ Madam,

Please find enclosed the following draft:

Doc No.	Title
CED 36(24991)WC	Draft Indian Standard Ball Valves for Water Works Purposes — Specification (ICS: 91.140.60)

Kindly examine the attached draft and forward your views stating any difficulties which you are likely to experience in your business or profession if this is finally adopted as National Standard.

**Last Date for Comments: 18 April 2024**

Comments if any, may please be made in the enclosed format and emailed at [ced003@bis.gov.in](mailto:ced003@bis.gov.in) or sent at the above address. Additionally, comments may be sent online through the BIS e-governance portal, [www.manakonline.in](http://www.manakonline.in).

In case no comments are received or comments received are of editorial nature, kindly permit us to presume your approval for the above document as finalized. However, in case comments, technical in nature are received, then it may be finalized either in consultation with the Chairman, Sectional Committee or referred to the Sectional Committee for further necessary action if so desired by the Chairman, Sectional Committee.

The document is also hosted on BIS website [www.bis.gov.in](http://www.bis.gov.in).

Thanking you,

**Yours faithfully,**

Sd/-

**Dwaipayan Bhadra**

**Scientist 'E' & Head**

**Civil Engineering Department**

**Email: [ced003@bis.gov.in](mailto:ced003@bis.gov.in)**

**Phone: +91-11 2323 5529**

**Encl: As above**

## FORMAT FOR SENDING COMMENTS ON THE DOCUMENT

[Please use A4 size sheet of paper only and type within fields indicated. Comments on each clause/sub-clause/table/figure, etc, be stated on a fresh row. Information/comments should include reasons for comments, technical references, and suggestions for modified wordings of the clause. **Comments through e-mail to [ced003@bis.gov.in](mailto:ced003@bis.gov.in) shall be appreciated.**]

**Doc. No.:** CED 03(24991)WC

**BIS Letter Ref:** CED 03/T-92

**Title:** Draft Indian Standard for Ball Valves for Water Works Purposes — Specification  
(ICS: 91.140.60)

Last date of comments: **18 April 2024**

**Name of the Commentator/ Organization:** \_\_\_\_\_

Clause/ Para/ Table/ Figure No. commented	Type of Comment (Technical/ Editorial/ General)	Comments/Modified Wordings	Justification of Proposed Change
1.			
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
13.			

*NOTE- Kindly insert more rows as necessary for each clause/table, etc.*

**BUREAU OF INDIAN STANDARDS****DRAFT STANDARD FOR COMMENTS ONLY**

*(Not to be reproduced without the permission of BIS or used as a Standard)*

*Draft Indian Standard*

**BALL VALVES FOR WATER WORKS PURPOSES — SPECIFICATION**

*(ICS: 91.140.60)*

---

**Sanitary Appliances and Water Fittings**  
**Sectional Committee, CED 03****Last Date for Comments:****18 April 2024**

---

**FOREWORD**

*(Formal clauses shall be added later)*

Ball valves are commonly used mechanical devices in water works to permit or prevent the flow of water through pipelines. These valves use a hollow/solid spherical closure member with a straight circular flow passageway in the centre, which supported between two seats, connected by a shaft to the operating mechanism, rotated to turn on-off the flow of water. One of the main advantages of ball valves is their ability to provide tight shutoff, which helps prevent leaks and ensures reliable operation. Additionally, ball valves are robust, easy to operate, maintain and have a low-pressure drop and high flow capacity. In water works, ball valves are often used to isolate sections of the pipeline for maintenance or repair. They are also used to turn on-off the flow of water through treatment facilities and distribution systems.

This Indian Standard aims to consider the UN SDG 6: Clean Water and Sanitation which is one of the 17 Sustainable Development Goals adopted by the United Nations in 2015. The use of ball valves in water works is related to SDG 6, because SDG 6 aims to ensure the availability and sustainable management of water and sanitation for all. The use of ball valves in water works helps to achieve this goal by allowing for efficient control and management of water flow, thereby ensuring safe and reliable water supply to communities.

Information to be provided by the purchaser is given under Annex B.

For the purpose of deciding whether a particular requirement of this standard is complied with the final value, observed or calculated, expressing the result of a test or analysis shall be rounded off in accordance with IS 2: 2022 'Rules for rounding off numerical values (second revision)'. The number of significant places retained in the rounded off value should be same as that of the specified value in this standard.

*Draft Indian Standard***BALL VALVES FOR WATER WORKS PURPOSES — SPECIFICATION****1 SCOPE**

This standard lays down the requirements for material, shape, dimensions, and performance requirements of floating type ball valves for applications in water works purposes. This standard covers the ball valves manufactured from copper alloys (brass, bronze), cast steel, and stainless steel and sizes ranging from DN8 to DN150.

**2 REFERENCES**

The standards given in Annex A contain provisions which, through reference in this text, constitute provisions of this standard. At the time of publication, the editions indicated were valid. All standards are subject to revision, and parties to agreements based on this standard are encouraged to investigate the possibility of applying the most recent editions of the standards listed in Annex A.

**3 TERMS AND DEFINITION**

**3.1 DN** — An alphanumeric designation of size that is common for components used in piping system, used for reference purposes, comprising the letter DN followed by a dimensionless number indirectly related to the physical size of the bore or outside diameter of the end connection, as appropriate. For example, a valve with nominal flow bore of 100 mm shall be specified as DN100.

**3.2 PN or Class** — An alphanumeric designation for pressure-temperature rating that is common for components used in a piping system, used for reference purposes, comprising the letters “PN” or “Class” followed by a dimensionless whole number indirectly related to the pressure retaining capability as a function of the temperature of the component. For example, for PN rated valves, pressure rating of PN16 shall have a maximum working pressure of 1.6 MPa at ambient temperature. For Class rated valves, specified as Class 150, shall have a maximum working pressure of 1.96 MPa at ambient temperatures.

**3.3 Ambient Temperature** — Temperature between 10 °C to 50 °C is considered as ambient temperature.

**3.4 Cold Working Pressure (CWP)** — The cold working pressure rating of the valve shell and components is the maximum allowable non-shock pressure at ambient temperature. The maximum working pressure at any other temperature shall not exceed this rated pressure.

**3.4 End-to-End Dimension** — Distance between the two planes, perpendicular to the valve axis, located at the external face of the body end ports of straight type screwed end, socket end, soldering end and crimping end valves.

**3.5 Face-to-Face Dimension** — Distance between the two planes perpendicular to

the valve axis located at the external face of the body end ports of straight type flanged end valves.

**3.6 Full Bore Valve** — The valve with an unobstructed opening, not smaller than the internal bore of the end connection. (see Fig. 4 and Fig. 5)

**3.7 Reduce Bore Valve** — The valve with a bore one size lower than the internal bore of the end connection. See Fig. 5A for reduced bore type valve. For example, for reduced bore DN50 the bore dimension is equal to that of full bore DN40.

**3.8 Trim** – The internal operating parts of the valve which are normally in contact with the service fluid (see Fig. 1A). The trim comprises the following:

- a) Stem, and
- b) Ball seating surface

**3.9 Operator** — The device (or assembly) for opening and closing of a valve. Operator can be:

- a) manual lever (see Fig. 1 A);
- b) gear box (see Fig. 1 B);
- c) actuator (Pneumatic and Electric, see Fig. 2 and Fig. 3 respectively)

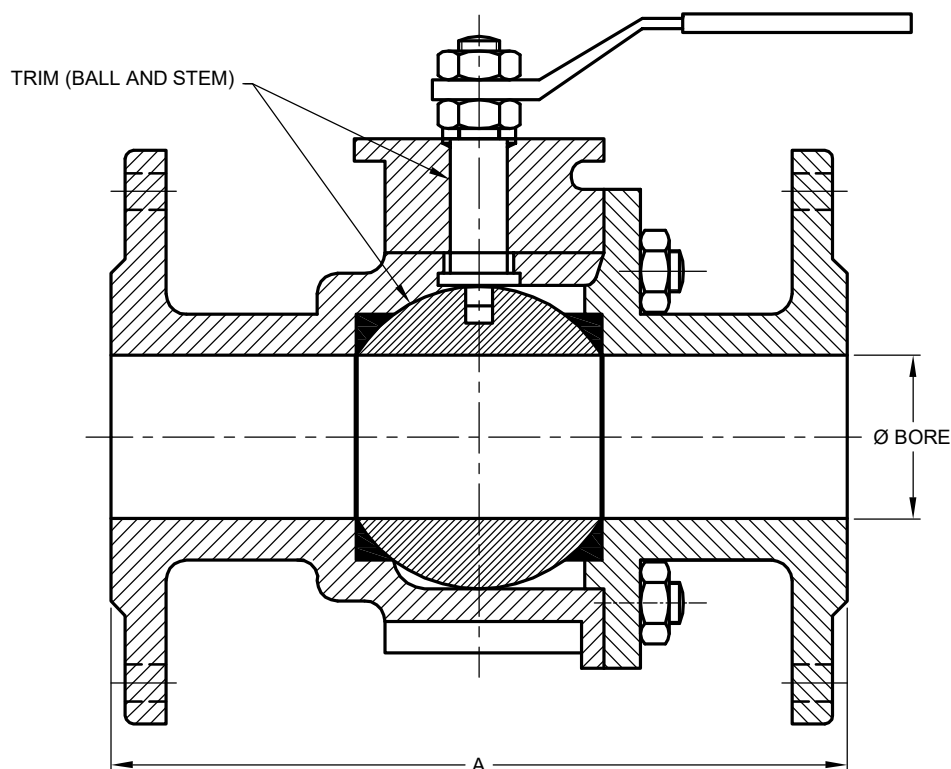


FIG. 1A MANUAL LEVER OPERATED VALVE

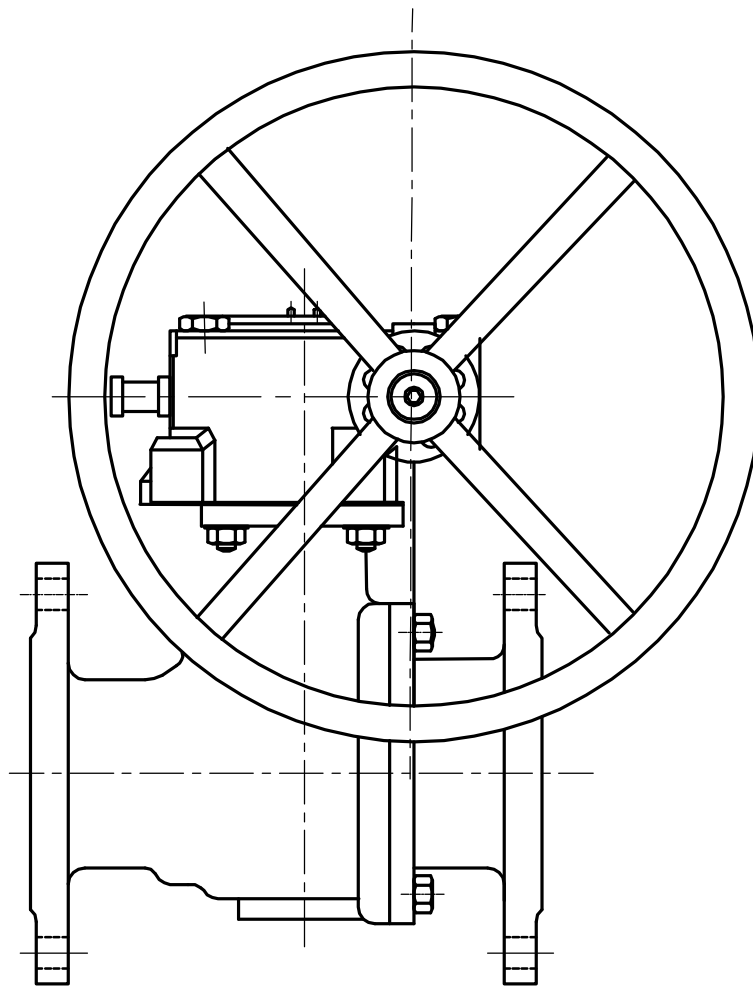


FIG. 1B GEAR OPERATED VALVE

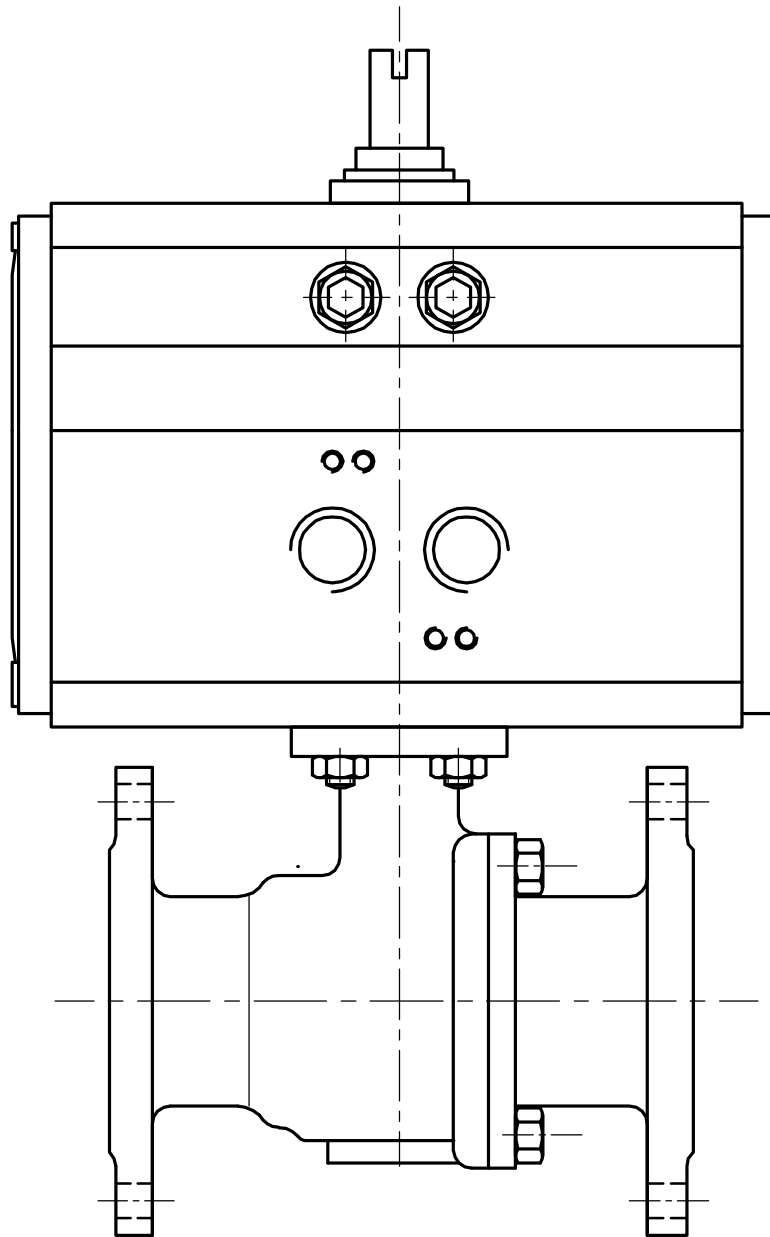


FIG. 2 PNEUMATIC ACTUATOR OPERATED VALVE




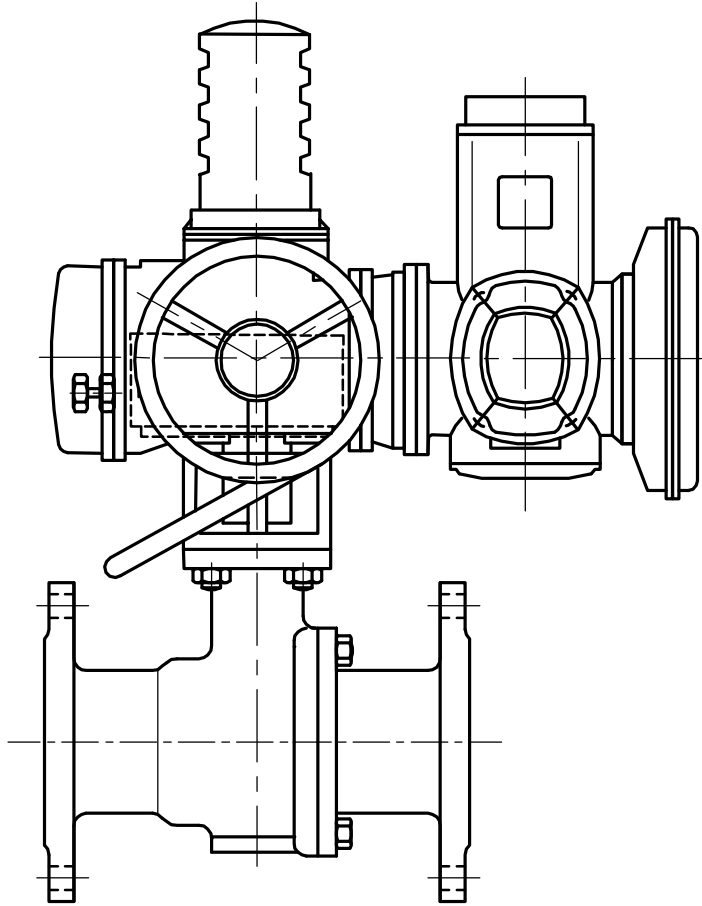


FIG. 3 ELECTRICAL ACTUATOR OPERATED VALVE


## 4 DESIGN

### 4.1 Ball Valve Construction


Ball valves shall be of full bore or reduced bore (see Fig. 5A) pattern and either of one piece or split construction (two piece/ three piece, see Fig. 4) with flanged end or screwed end or socket weld end or soldering end or crimping end. (see Fig. 5)

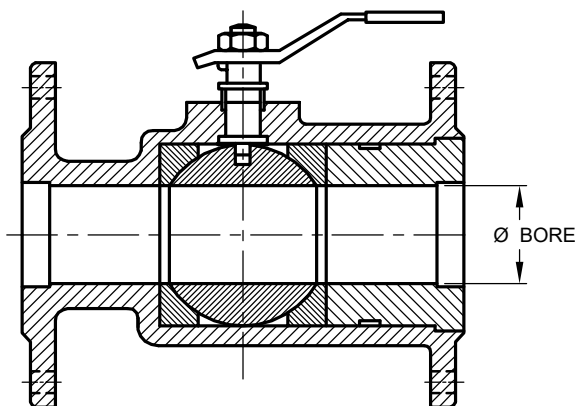


4A ONE PIECE FLANGED ENDS CONSTRUCTION

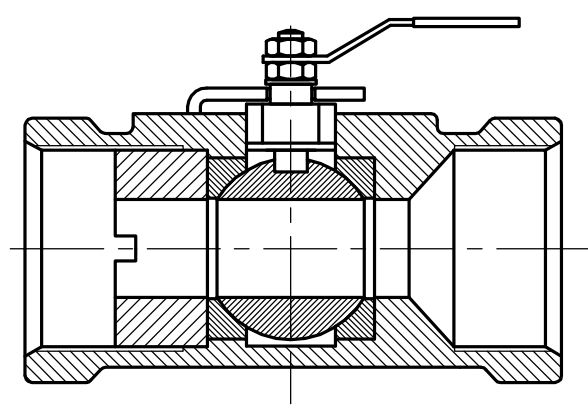


4D ONE PIECE CONSTRUCTION

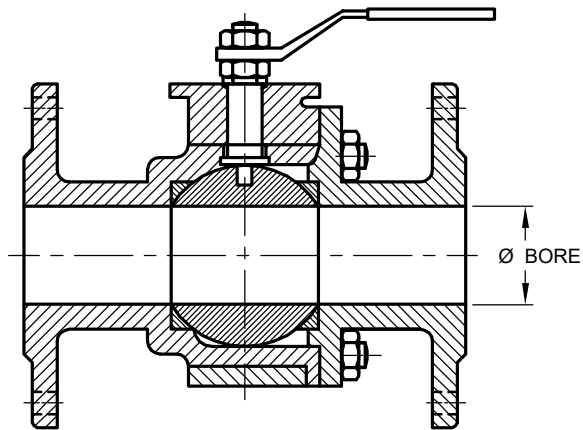


4B TWO PIECE FLANGED ENDS CONSTRUCTION

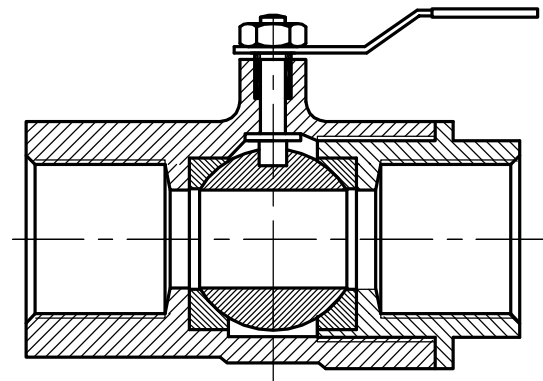

4E TWO PIECE CONSTRUCTION

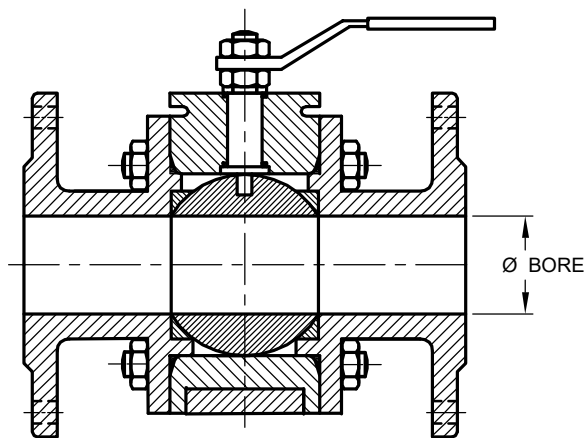


4C THREE PIECE FLANGED ENDS CONSTRUCTION

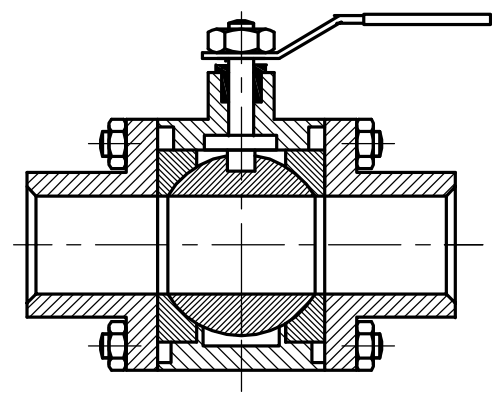


4F THREE PIECE CONSTRUCTION

NOTE — Design details are not shown. These illustrations are not intended to limit design, or to indicate any preferred design.


FIG. 4 EXAMPLES OF VALVE CONSTRUCTION TYPES

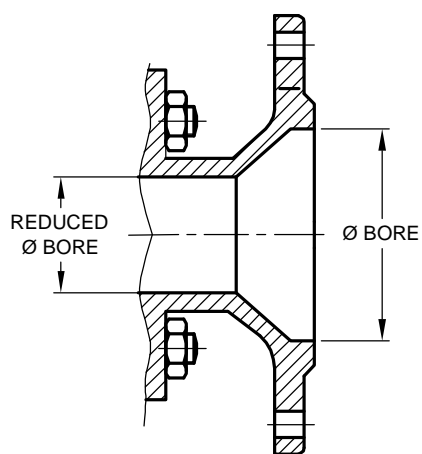


5A REDUCED BORE. FLANGED END

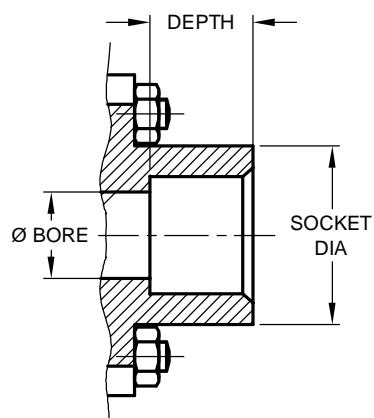

5B SOCKET WELD END

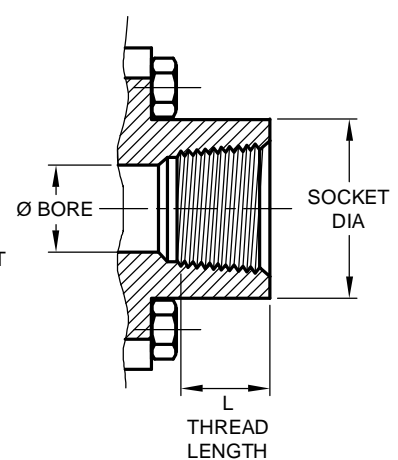

5C SCREWED END

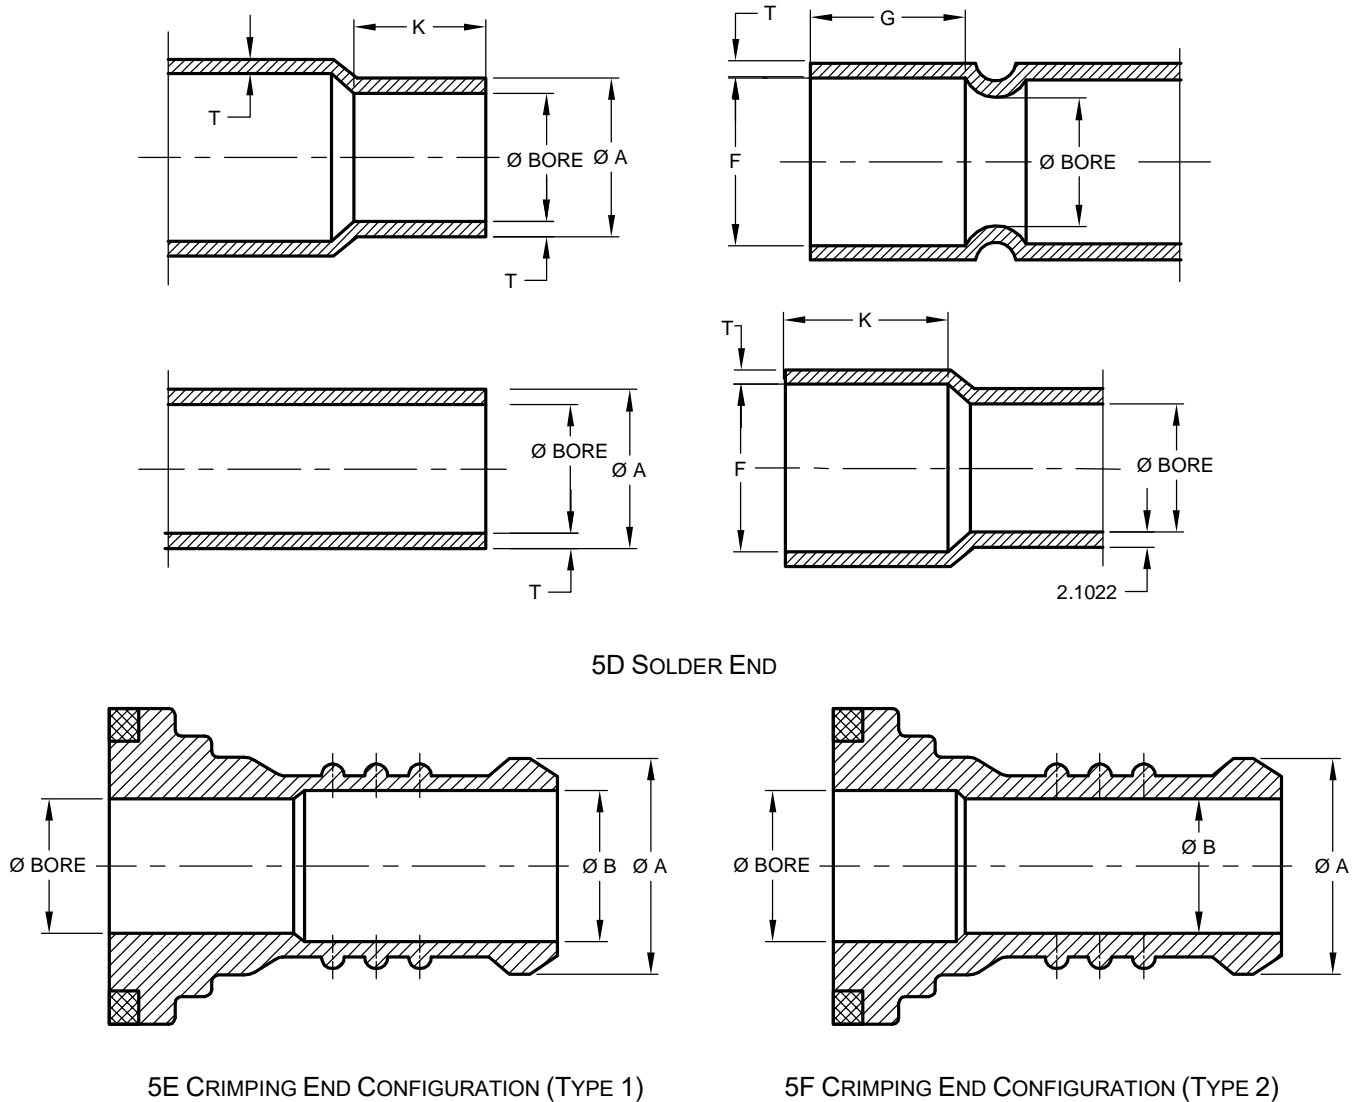

NOTE — Design Details are not shown. These illustrations are not intended to limit design, or to indicate any preferred design.

FIG. 5 EXAMPLES OF VALVE END TYPES

## 4.2 Nominal Sizes

**4.2.1** The nominal size (DN) for flanged end valve shall be 15 mm, 20 mm, 25 mm, 32 mm, 40 mm, 50 mm, 65 mm, 80 mm, 100 mm, or 150 mm.

**4.2.2** The nominal size (DN) for screwed end/ socket weld end/ soldering end/ crimping end valves shall be 8 mm, 10 mm, 15 mm, 20 mm, 25 mm, 32 mm, 40 mm, 50 mm, 65 mm, 80 mm, or 100 mm.

## 4.3 Rating

The ball valves covered by this standard shall be furnished in nominal pressure (PN) or classes as given in Table 1 and Table 2 respectively, at ambient temperature.

**Table 1 Maximum Working Pressure for Different Pressure Ratings**  
(Clause 4.3)

SI No.	Pressure Rating	Maximum Working Pressure MPa
(1)	(2)	(3)
i)	PN6	0.6
ii)	PN10	1.0
iii)	PN16	1.6
iv)	PN20	2.0
v)	PN25	2.5
vi)	PN30	3.0
vii)	PN40	4.0

**Table 2 Maximum Working Pressure for Different Class Ratings**  
(Clause 4.3)

SI No.	Class Rating	Maximum Working Pressure MPa
(1)	(2)	(3)
i)	Class 150	1.96
ii)	Class 300	5.17

**4.4 Valve Bore Dimensions**

Valve bore dimensions for full bore and reduced bore shall be as given in Table 3, for different sizes of the valve.

**Table 3 Minimum Bore Diameter for Valves**  
(Clause 4.4, Table 6 and Table 9)

SI NoI	DN	Minimum Bore Diameter mm	
		Full Bore	Reduced Bore
(1)	(2)	(3)	(4)
i)	8	5.0	N.A.
ii)	10	8.0	5.0
iii)	15	12.7	8.0
iv)	20	19.0	12.7
v)	25	24.0	19.0
vi)	32	30.0	24.0

SI NoI	DN	Minimum Bore Diameter mm	
		Full Bore	Reduced Bore
(1)	(2)	(3)	(4)
vii)	40	37.0	30.0
viii)	50	44.0	37.0
ix)	65	62.0	44.0
x)	80	74.0	62.0
xi)	100	96.0	74.0
xii)	150	148.0	96.0

#### 4.5 Face-to-Face and End-to-End Dimensions

**4.5.1** Unless otherwise agreed between manufacturer and purchaser face-to-face (A) dimensions of flanged end valves shall be in accordance with Table 4.

**4.5.2** Tolerances on face-to-face (A) dimensions shall be  $\pm 1.5$  mm for sizes up to DN150.

**4.5.3** The end-to-end dimension for screwed end, socket weld end, soldering end, and crimping end valves shall be as declared by the manufacturer.

**Table 4 Face-to-Face Dimension of Flanged End Valves**  
(Clause 4.5.1)

SI No.	DN, Min. mm	A mm	
		PN6-PN16/ Class 150	PN 25-PN40/ Class 300
(1)	(2)	(3)	(4)
i)	15	108	140
ii)	20	117	152
iii)	25	127	165
iv)	32	140	178
v)	40	165	190
vi)	50	178	216
vii)	65	191	241
viii)	80	203	283
ix)	100	229	305
x)	150	394	403

**4.6 Valve Ends****4.6.1 Flanged End**

The flanges of valve shall be integral/ welded with the body. The flanges shall be machined flat or with raised face. The dimensions of flanges shall be as per IS 6392/ IS 1538/ IS 9523 or as agreed between manufacturer and purchaser.

**4.6.2 Socket Weld Ends for Stainless Steel Materials**

The socket bore axis shall coincide with the end entry axis. The socket end faces shall be perpendicular to the socket bore axis. The socket bore diameter and the minimum depth of socket weld ends shall be as specified in Fig. 5B and Table 5.

**Table 5 Bore Diameter and Depth for Socket Weld Ends**  
(Clause 4.6.2)

Sl No.	DN mm	Socket Diameter* mm	Depth, <i>Min</i> mm
(1)	(2)	(3)	(4)
i)	8	14.1	9.5
ii)	10	17.5	9.5
iii)	15	21.7	10
iv)	20	27.0	13
v)	25	33.8	13
vi)	32	42.5	13
vii)	40	48.6	13
viii)	50	61.1	16
*The applicable diametric tolerance is 0 to +0.5 mm			

**4.6.3 Solder Ends for Copper Alloy Materials**

It shall be the responsibility of the user to select a solder composition as per IS 193 that is compatible with the service conditions. Inside diameter and outside diameter of the solder ends shall be as agreed between manufacturer and purchaser (see Fig. 5D and Table 6).

**Table 6 – Solder End Dimensions in mm**  
(Clause 4.6.3)

SI No.	Valve Size	Male End (Type 1)			Female End (Type 2)			Minimum Wall Thickness T	Inside Diameter Ø Bore
		Outside Diameter ØA		Length K	Inside Diameter ØF		Length G		
		Min.	Max. <sup>1</sup>		Min.	Max. <sup>1</sup>			
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
i)	DN8	9.47	9.55	7.0	9.58	9.68	5.5	0.58	As per Table 3 of full-bore diameter
ii)	DN10	12.62	12.73	7.0	12.75	12.85	5.5	0.66	
iii)	DN15	15.80	15.90	9.0	15.93	16.03	7.5	0.74	
iv)	DN20	22.15	22.25	10.5	22.28	22.38	9.0	0.84	
v)	DN25	28.50	28.63	13.5	28.65	28.75	12.0	1.02	
vi)	DN32	34.85	34.98	16.5	35.00	35.10	15.0	1.12	
vii)	DN40	41.17	41.33	19.5	41.35	41.48	18.0	1.30	
viii)	DN50	53.87	54.03	20.6	54.05	54.18	19.1	1.50	
ix)	DN65	66.57	66.73	21.5	66.75	66.88	20.0	1.70	
x)	DN80	79.27	79.43	21.5	79.45	79.58	20.0	1.91	
xi)	DN100	104.67	104.83	22.5	104.85	104.93	21.0	2.44	
<sup>1</sup> Ovality of the diameter shall not exceed 1 percent of the maximum diameter.									
Abbreviations:									
Type 1 – Solder joint fitting end made to receive copper tube diameter (Male)									
Type 2 – Solder joint fitting end made to receive copper tube diameter (Female)									

**4.6.4 Screwed Ends****4.6.4.1 Screwed end for copper alloy materials**

The threaded end axis shall coincide with the end entry axis. The minimum wall thickness at the threaded end and the minimum thread length shall be as specified in Table 7.

**Table 7 Minimum Wall Thickness and Minimum Thread Length for Screwed Ends of Copper Alloy Materials**  
(Clause 4.6.4.1)

SI No.	DN mm	PN16, PN20, PN30, and PN40	Thread Length, <i>Min.</i> mm
		Class 150 and Class 300	
		Wall Thickness, <i>Min.</i> mm	
(1)	(2)	(3)	(4)
i)	8	1.5	5.5
ii)	10	1.6	5.5
iii)	15	1.7	7.5
iv)	20	1.8	9.0
v)	25	1.9	12.0
vi)	32	2.2	15.0
vii)	40	2.5	18.0
viii)	50	3.1	19.1
ix)	80	4.0	20.0
x)	100	5.0	21.0

#### 4.6.4.2 Screwed end for stainless steel materials

The threaded end axis shall coincide with the end entry axis. The minimum wall thickness at the threaded end shall be as specified in Table 8.

**Table 8 Minimum Wall Thickness and Minimum Thread Length for Screwed Ends of Stainless Steel Materials**  
(Clause 4.6.4.2)

SI No.	DN mm	PN6, PN10, PN16, PN25, and PN40	
		Class 150 and Class 300	
		Wall Thickness, <i>Min.</i> mm	Thread Length, L, <i>Min.</i> mm
(1)	(2)	(3)	(4)
i)	8	3.0	10.2
ii)	10	3.0	10.4
iii)	15	3.3	13.6
iv)	20	3.6	13.9
v)	25	3.8	17.3
vi)	32	3.8	18.0
vii)	40	4.1	18.4
viii)	50	4.6	19.2

An approximate 45-degree lead in chamfer having an approximate depth of one half



of the thread pitch shall be applied at each threaded end. The ends with parallel pipe threads shall meet the requirements of IS 2643. The ends with taper pipe threads shall meet the requirements of IS 554. The ends with any other pipe thread requirements shall be as agreed between the manufacturer and the purchaser.

#### **4.6.5 Crimping Ends for Copper Alloy materials**

The pressing together of a flexible ring to secure a watertight seal between pipe and a fitting. It shall be the responsibility of the manufacturer to size the crimping ends which is compatible with the service conditions on mutual agreement with the purchaser (see Fig. 5E, Fig. 5F and Table 9).

**Table 9 – Crimping End Dimensions in mm**  
(Clause 4.6.5)

SI No.	Valve Size	Outside Diameter, Average		Maximum Crimping End Diameter	Figure 6 Type	Valve Bore
		ØA	Tolerance (±)	ØB		Ø Bore
(1)	(2)	(3)	(4)	(5)	(6)	(7)
i)	DN8	9.52	0.08	6.38	E-1	As per Table-3 of full-bore diameter
ii)	DN10	12.70	0.08	9.14	E-1	
iii)	DN15	15.88	0.10	12.32	E-2	
iv)	DN20	22.22	0.10	17.28	E-2	
v)	DN25	25.58	0.12	19.22	E-2	
vi)	DN32	34.92	0.12	27.16	E-2	
vii)	DN40	41.28	0.16	32.14	E-2	
viii)	DN50	53.98	0.16	41.98	E-2	
ix)	DN65	66.68	0.18	51.86	E-2	
x)	DN80	79.38	0.20	61.74	E-2	
xi)	DN100	104.78	0.23	81.50	E-2	

## **4.7 Design**

### **4.7.1 General**

**4.7.1.1** The valve design and materials of construction shall be structurally suitable for their stated pressure ratings and temperature limits. Any additional metal thickness above the thickness necessary to contain pressure such as may be needed for assembly stresses, valve closing stresses, shapes other than circular, stress concentrations, and corrosion allowances, shall be determined by the manufacturer.

#### **4.7.1.2 Body shell thickness for copper alloy materials**

The minimum wall thickness of forged copper alloys is the manufacturer's design which shall be structurally suitable for their pressure and temperature limits.

**4.7.1.3** The minimum wall thickness of forged copper alloys is the manufacturer's design which shall be structurally suitable for their pressure and temperature limits.

**4.7.1.4 Joints**

The design of the valve shall be such as to provide against detrimental distortion under hydrostatic test conditions, assembly stresses, closing stresses, pipe reaction stresses, or when rated pressure is applied across a closed valve.

**4.7.1.5** Bolting shall be threaded in accordance with the design calculations.

**4.7.1.6 End connections**

- a) Flanged ends shall be in accordance with IS 6392 for steel or as agreed between the manufacturer and purchaser.
- b) Threaded pipe ends shall have taper pipe threads in accordance with IS 2635/ IS 554 or as agreed between the manufacturer and purchaser.
- c) Socket dimensions of socket welding ends shall be in accordance with IS 1239 (Part 2) or as agreed between the manufacturer and purchaser.
- d) Solder end dimensions of solder joint ends shall be made by agreement between manufacturer and purchaser.
- e) Crimping end dimensions shall be made by agreement between manufacturer and purchaser.

**4.7.1.7 Stems**

To prevent removal of the stem while the valve is pressurized, the valve shall be designed so that the stem seal retainer assembly (gland) alone does not retain the stem.

**4.7.1.8** In those cases where service conditions require electrical continuity between the ball & stem and stem & body, the purchaser must so specify.

**4.7.1.9 Stem packing**

The valve shall have provisions for the adjustment of a gland or packing nut in order to obtain a seal at the stem packing. The exception is for valves with elastomeric stem seals, where adjustment is not possible.

**4.7.1.10 Corrosion resistant coating**

On manufacturer and purchaser agreement based on the application requirements.

**4.7.2 Body shell thickness for steel valves**

The minimum body wall thickness for cast steel valves;  $t_m$  shall be as specified in Table 10. Local areas having less than minimum wall thickness are acceptable provided that all the following conditions are satisfied:

- a) The area sub-minimum thickness can be enclosed by a circle, the diameter of which is not greater than  $0.35\sqrt{dt_m}$ , where  $d$  is the minimum bore diameter and  $t_m$  is the minimum thickness.
- b) The measured thickness is not less than  $0.75t_m$

- c) Enclosed circles are separated from each other by an edge-to-edge distance not less than  $1.75\sqrt{dt_m}$

**Table 10 Minimum Body Wall Thickness for Steel Valve,  $t_m$ , mm**  
(Clause 4.7.2)

SI No.	DN	Up to PN16		PN25 and PN40	
		Class 150		Class 300	
		Full Bore	Reduced Bore	Full Bore	Reduced Bore
i)	8	3.1	N.A.	3.3	N.A.
ii)	10	3.2	3.1	3.3	3.3
iii)	15	3.2	3.2	3.5	3.4
iv)	20	3.3	3.3	3.7	3.6
v)	25	4.4	3.9	4.8	4.2
vi)	32	4.5	4.5	5.1	4.9
vii)	40	4.7	4.6	5.3	5.2
viii)	50	5.3	5.0	6.0	5.7
ix)	65	5.6	5.4	6.5	6.3
x)	80	5.8	5.7	7.0	6.8
xi)	100	6.3	6.1	7.7	7.4
xii)	150	7.1	6.9	9.3	8.9

#### 4.7.3 Body shell thickness

**4.7.3.1** The minimum body wall thickness for cast iron valves;  $t_m$  shall be as per below formula:

$$t_m = \frac{1.5P_c D_i}{(2S) - (1.2P_c)} + c$$

where,

- $t_m$  = minimum wall thickness, in mm;
- $P_c$  = design pressure, in MPa;
- $D_i$  = inside diameter, in mm;
- $S$  = stress factor, in MPa, ( $S = 26$  MPa for cast iron;  $120.7$  MPa for cast steel); Refer Table 12 for other applicable materials.
- $c$  = a constant, in mm, to compensate for corrosion.

**4.7.3.2** The values of the design pressure,  $P_c$  shall be as follows:

<b>Designation</b>	<b>Pressure, P<sub>c</sub> MPa</b>
PN6	0.76
PN10	1.21
PN16	1.93
PN25	3.02
PN40	4.83
Class 150	2.59
Class 300	5.17

**4.7.3.3** The values of constant, c (in mm), used to calculate tabulated minimal thickness, shall be as follows:

<b>Designation</b>	<b>PN6</b>	<b>PN10</b>	<b>PN16</b>	<b>PN25</b>	<b>PN40</b>	<b>Class 150</b>	<b>Class 300</b>
c for D <sub>i</sub> 3 mm to 24 mm	3	3	3	3	3	3	3
c for D <sub>i</sub> 25 mm to 49 mm	4	4	4	4	4	4	4
c for D <sub>i</sub> 50 mm to 100 mm	4.5	4.5	4.5	4.4	4.4	4.5	4.4
c for D <sub>i</sub> 101 mm to 1300 mm	4.7	4.7	4.7	4.4	4.4	4.7	4.4

#### **4.7.4 Bolted Body Joint**

The minimum body joint bolt load shall be as per below formula,

$$P_c \frac{A_g}{A_b} \leq K_2 S_a \leq 7000$$

where,

- P<sub>c</sub> = pressure rating class designation
- A<sub>g</sub> = area bounded by the effective outside periphery of a body gasket
- A<sub>b</sub> = total effective bolt tensile stress area
- S<sub>a</sub> = expressed in MPa, when greater than 137.9 MPa, use 137.9 MPa
- K<sub>2</sub> = 50.76 /MPa

#### **4.7.5 Bolted Bonnet or Cover Joint**

The minimum body joint bolt load shall be as per below formula:

$$P_c \frac{A_g}{A_b} \leq K_1 S_a \leq 9000$$

where,

- $P_c$  = pressure rating class designation  
 $A_g$  = area bounded by the effective outside periphery of a body gasket  
 $A_b$  = total effective bolt tensile stress area  
 $S_a$  = expressed in MPa, when greater than 137.9 MPa, use 137.9 MPa  
 $K_1$  = 65.26 /MPa

## 5 VALVE OPERATION

**5.1** The ball valves shall be designed for direct operation by lever or wrench or by gear box, and actuator.

**5.2** The maximum force required at the handle wheel or wrench to apply the breakaway torque or thrust shall not exceed 360 N.

**5.3** Wrenches that are integral design shall not be longer than twice the face-to-face dimensions for flanged end valves.

**5.4** Manually operated valves shall close by turning the lever or wrench in a clockwise direction when viewed from top of the operating shaft. Lever shall mark 'CLOSE' or 'OPEN' with an arrow to indicate the direction (see Fig. 6). Alternatively, this marking may be shown on a plate secured below the lever nut.

**5.5** Wrenches shall be designed so that they are parallel to the flow passage of ball. These shall be supplied as separate items and only when specified by the customer. When wrench is used it shall be plated to IS 1038 Normal Class and marked with direction of shut and open on the wrench. The wrench shall be covered with sleeve of poly vinyl chloride (PVC). In any case the sleeve shall be marked with shut and open and arrow showing the direction for the position. And wrench shall be fitted in such a way that it held securely, they may be removed and replaced when necessary.

**5.6** Suitable stops shall be provided for both fully open and fully closed positions of valves.

**5.7** If chains wheel or gear operation is required, it shall be specified in order, which shall also specify any chain to be supplied or type of gearing.

**5.8** If actuators are used for the operation of valves, the details of the valve operating the actuator, its power supply together with the design pressure, and the pressure differential across the valve shall be specified in the purchase order.

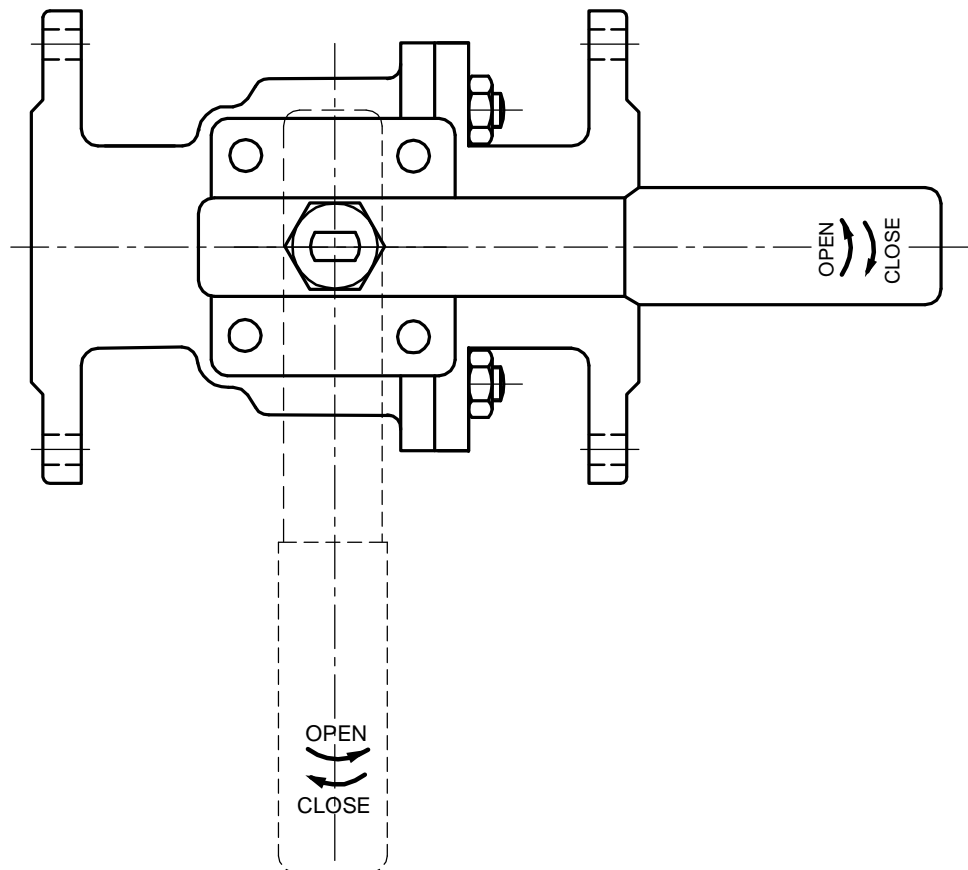


FIG. 6 HAND LEVER OPEN-CLOSE DIRECTION MARKING

## 6 MATERIALS OF CONSTRUCTION

**6.1** Different materials used in the manufacturing of ball valves shall conform to the requirements as given in Table 11.

**Table 11 Requirements for Material of Construction of Ball Valves**  
(Clause 6.1)

SI No.	Component	Material	Referred IS Grade
(1)	(2)	(3)	(4)
1.	Body and connectors	Forged brass – Low lead	IS 6912 FLB IS 6912 FMnB IS 6912 FHTB1 IS 6912 FHTB2 IS 6912 FNS
		Forged brass – Lead free	IS 6912 FNB IS 6912 FHTB3 IS 6912 FHTB4 IS 6912 FHTB5

SI No.	Component	Material	Referred IS Grade
(1)	(2)	(3)	(4)
		Brass – Gravity die casting	IS 1264 DCB-2
		Leaded tin bronze casting	IS 318 LTB-2
		Stainless steel bars	IS 6603 X12Cr12 Grade SS-304,316
		Cast steel	IS 1030
		Cast iron	IS 210 FG260 <sup>2)</sup>
		Spheroidal graphite iron casting	IS 1865
2.	Ball	Stainless steel or brass	12 Cr 12 of IS 6603 IS 6912 FLB IS 6912 FMnB IS 6912 FHTB1 IS 6912 FHTB1 IS 6912 FNS IS 319 Grade 1 IS 6912 FNB IS 6912 FHTB3 IS 6912 FHTB4 IS 6912 FHTB5 SS304/ SS316 equivalent bar form
3.	Stem	Stainless steel or brass	12 Cr 12 of IS 6603 304/316 OR FLB of IS 6912
		Forged brass	IS 1264 DCB-2 IS 6912 FLB IS 6912 FMnB IS 6912 FHTB1 IS 6912 FHTB1 IS 6912 FNS IS 319 Grade 1 IS 6912 FNB IS 6912 FHTB3 IS 6912 FHTB4 IS 6912 FHTB5
		Extruded brass	IS 319 Grade-I or Grade-II (Half Hard)
4.	Seat	PTFE/GFT/CFT	—

SI No.	Component	Material	Referred IS Grade
(1)	(2)	(3)	(4)
5.	Gland nut	Carbon steel	C-45 of IS 1570
		Leaded-tin bronze	LTB-2 of IS 318
		Brass	IS 6912 FLB IS 6912 FMnB IS 6912 FHTB1 IS 6912 FHTB1 IS 6912 FNS IS 319 Grade 1 IS 6912 FNB IS 6912 FHTB3 IS 6912 FHTB4 IS 6912 FHTB5 SS 304/ SS 316 equivalent bar form
6.	Gland packing	PTFE/Graphite	–
7.	Thrust washer	GFT	–
8.	Bolting nut	Carbon steel	IS 1570 (Part 2) C45 or EN8 or SS 304
9.	`O' ring	Viton/EPDM/Nitrile	
10.	Handle	Carbon steel (with suitable corrosion preventive coatings)	IS 2858 Gr. I or Gr. II IS 2062 Grade B SS304 IS 1038 IS 513 (Part 2)
11.	Handle sleeve	PVC	–
12.	Stem nut	Carbon steel	IS1570 C-45

The manufacturer shall procure and maintain records of the certificate for the raw material testing from the raw material supplier.



**Table 12 Stress Factors for Body Shell Materials**  
(Clause 4.7.3.1)

SI No.	Referred IS Grade	Allowable Stress MPa	Material	Application
(1)	(2)	(3)	(4)	(5)
i)	IS 6912 FLB	62	Forged Brass– Low lead	Screwed Ends, Soldering Ends, Crimping Ends, Body Shell
ii)	IS 6912 FMnB	79		
iii)	IS 6912 FHTB1	120		
iv)	IS 6912 FHTB2	120		
v)	IS 6912 FNS	92		
vi)	IS 6912 FNB	68	Forged Brass– Lead Free	
vii)	IS 6912 FHTB3	217		
viii)	IS 6912 FHTB4	200		
ix)	IS 6912 FHTB5	267		
x)	IS 318 LTB-2	67	Leaded Tin Bronze Castings	
xi)	IS 6603 X12Cr12 Grade	246	Stainless Steel Bars	Screwed Ends, Crimping Ends
xii)	IS 6603 X04Cr19Ni9 (SS 304)	163		
xiii)	IS 6603 X04Cr17Ni12M02 (SS 316)	163		
xiv)	IS 1030 Gr.230- 450W	153	Cast Steel	Flanged Ends, Body Shell
xv)	IS 210 FG260	29	Cast Iron	
xvi)	IS 1865 400/15	68.5	SGI Casting	
xvii)	IS 1865 400/18	68.5		
xviii)	IS 1865 500/7	72.5		
NOTES				
1 Where the requirements for the material of any component or the relevant Indian Standard designation for any material are not specified, these shall be as agreed between the manufacturer and the purchaser.				
2 In body and connector, cast iron shall not be used for pressure ratings more than PN16. For higher pressure ratings and class rated valves use steel/copper alloy as material of construction.				

## 7 PERFORMANCE REQUIREMENTS

**7.1** The valve shall be tested and shall meet the performance requirements as specified in **7.2** and **7.3**.

### 7.2 Pressure Tests for Steel Valves

The pressure tests indicated in this standard shall be carried out on each valve. Each valve shall be given a shell pressure test and a seat closure test as per **7.2.1** and **7.2.2**, respectively. Sealing compounds, greases, or oils shall be removed from seating surfaces prior to pressure testing. It is permissible, however, for a film of oil that is not heavier than kerosene to be applied to prevent metal-to-metal sealing surfaces from galling.

#### 7.2.1 Shell Test (HYD)

The hydrostatic test for the shell of the valve shall be carried out at a gauge pressure not less than 1.5 times the pressure rating at ambient temperature rounded off to the next higher 1 bar increment, for the duration as mentioned in Table 13. During these tests, the ball is in the half-open position to assure full pressurization of the valve shell. Visually detectable leakage through pressure boundary walls is not acceptable. There shall be no harmful inelastic deformation during or after tests. Leakage from packing shall not be cause for rejection; it shall be demonstrated that the packing will not leak at the rated working pressure of the valve. The test fluid shall be as per **7.4**.

#### 7.2.2 Closure Test (HYD)

The closure tightness test shall be a liquid test with the test fluid at a pressure not less than 1.1 times the rated pressure at ambient temperature for the duration as mentioned in Table 13, ball to be closed for test and one end of the valve shall be opened in air. Over the duration of the closure test, the maximum permitted leakage rate past the seats shall be zero leakage. The test fluid shall be as per **7.4**.

#### 7.2.3 Closure Test (Gas)

**7.2.3.1** Valves shall be subjected to an air seat test at shall be 0.6 MPa  $\pm$  0.1 MPa. Over the duration of the closure test as mentioned in Table 13, the maximum permitted leakage rate past the seats shall be zero leakage. The test fluid shall be as per **7.4**

**7.2.3.2** The applicable closure test of **7.2.2** and **7.2.3** shall be applied in one flow direction at a time for each seating direction. Over the duration of the gas closure test, the maximum permitted leakage rate past the seats shall be zero leakage.

**7.2.3.3** For the purposes of the closure test (gas), zero leakage is defined as 3 mm<sup>3</sup> (1 bubble) over the duration of the test.

#### 7.2.4 Test Duration

The test duration shall confirm to the requirements given in Table 13. Test duration starts once the valve leakage rate is stabilized.

**Table 13 Minimum Duration for Pressure Tests**  
(Clauses 7.2.1, 7.2.2, 7.2.3, and 7.2.4)

SI No.	Valve Size	Minimum Test Duration s	
		Shell	Closure
(1)	(2)	(3)	(4)
i)	DN ≤ 50	15	15
ii)	65 ≤ DN ≤ 150	60	60

### 7.3 Pressure Tests for Copper Alloy Valves

#### 7.3.1 Shell Test

**7.3.1.1** Each valve, except as noted in **7.3.1.2** and **7.3.1.3**, shall be given a shell test, at a pressure of 1.5 times the CWP, and rounded off to the next higher 0.1 MPa. The test fluid shall be air, gas, water, or liquids with a viscosity no greater than that of water. The test fluid temperature shall be at ambient temperature. The duration of the test shall be as given in Table 14.

**7.3.1.2** For valves having CWP no greater than 6.9 MPa, the manufacturer may, as a substitute for the test specified in **7.3.1.1** test each valve using gas at a minimum pressure of 0.6 MPa for a duration of not less than as given in Table 14. In order to exercise this option, the manufacturer must be able to certify that a production sample of the valve model so tested has been subjected to a hydrostatic shell test of at least 2.5 times CWP with no detrimental distortion as evidenced by a subsequent seat test. The manufacturer shall sample production lots as per Annex C.

**7.3.1.3** The ball shall be in such a position during the shell test as to assure full pressurization of the valve shell.

**7.3.1.4** When tested with a liquid, the valve exterior shall show no visible leakage. When tested with gas, the valve shall show no visible leakage when immersed in water or any other non-corrosive solution.

**7.3.1.5** Visually detectable leakage through pressure boundary walls is not acceptable. Leakage through adjustable stem packing during testing shall not be the cause for rejection. The stem packing or stem seals shall be capable of retaining pressure at least equal to the rated cold working pressure of the valve without visible leakage.

**7.3.1.6** When volumetric loss testing devices are used the valve manufacturer must be able to demonstrate that the leakage sensitivity of the device produces results that are equivalent to those which are acceptable when visual examination methods are employed.

**Table 14 Seat/Shell Test Duration (Visual Test Methods)**  
(Clauses 7.3.1.1, 7.3.1.2 and 7.3.2.1)

SI No.	Seat/Shell Test Duration <sup>(a)</sup> (Min)		
	s		
	Air	Hydrostatic	
	Valve Size (DN)	Valve Size (DN)	
	8-150	8-50	5-100
(1)	(2)	(3)	(4)
i)	5	15	60
<sup>(a)</sup> Time duration is period of inspection after valve is fully prepared and under shell test pressure.			

### 7.3.2 Closure Test

**7.3.2.1** Following the shell test, each valve shall be given a closure seat test. At the manufacturer's option, this test may be either a hydrostatic closure test at a pressure no less than 1.1 times of the closure pressure rating or an air closure test at a minimum pressure of 0.6 MPa. The duration of the test shall be as set forth in Table 14.

**7.3.2.2** The test pressure shall be applied successively on each side of the closed valve. As an alternate method for the 0.6 MPa minimum air test, the pressure may be applied inside the body cavity with the ball closed and both sides open for inspection. The method of seat leakage testing on each seat shall result in a filled or pressurized cavity between the seats to assure that no seat leakage can escape detection because of gradual and incomplete pressurization or filling of the cavity during the test duration.

**7.3.2.3** Valves marked as one-way valves require a closure test only in the direction of the flow.

**7.3.2.4** There shall be no visible leakage past the seat for the duration of the test for valves with resilient (polymeric or elastomeric) seats.

**7.3.2.5** The term "no visible leakage" applied to a hydrostatic test liquid is defined as a leak rate that will produce no visible weeping or formation of drops at the test pressure and for the duration of the test.

**7.3.2.6** The term "no visible leakage" applied to air or gas testing is defined as a leak rate that will produce no visible formation of bubbles in a water immersion test or after the application of a leak detection fluid at the test pressure and for the duration of the test. (This is equivalent to term "zero leakage" specified in 7.2.3.3)

**7.3.2.7** For automatic leak detection methods, this definition shall be considered equivalent to a leak rate no greater than  $6.7 \times 10^{-4}$  ml/sec with a pressure differential of 0.6 MPa to 0.7 MPa (5.5 to 6.9 bar) for application to valves DN150 and smaller.

**7.3.2.8** The maximum allowable leakage rate on each seat of non-resilient seated,

except metal-seated, valves for the duration of the test shall be  $2.23 \times 10^{-3}$  of a standard cubic meter of air per hour per mm of nominal valve size, or a maximum of  $7.87 \times 10^{-6}$  cubic meters of hydrostatic media per hour per mm of nominal valve size, at the test pressure specified in **7.2.1**.

**7.3.2.9** When volumetric loss testing devices are used, the valve manufacturer must demonstrate that the leakage sensitivity of the device produces results that are equivalent to or better than those which are acceptable when visual examination methods showing no leakage are employed.

## **7.4 Test Fluid**

**7.4.1** Hydrostatic tests shall be carried out with water at ambient temperature containing water soluble oil or suitable rust inhibitor. The use of any other liquid is subject to agreement between the manufacturer and purchaser. And the viscosity of the same shall in no case be greater than that of water.

**7.4.2** The fluid for pneumatic tests shall be either air or inert gas. Air when used shall be free from oil as much as possible.

## **7.5 Test Gauges**

**7.5.1** The gauges used for pressure testing shall be calibrated at intervals not exceeding six months by an independent competent authority if the manufacturer does not have such facilities. The results shall be recorded and shall be liable to inspection and verification by the purchaser's representative for acceptance as and when required.

**7.5.2** In all the pressure tests, the test pressure shall be measured for the stated duration without continuous use of any input to pressure build-up by mechanical or other means.

## **8 SAMPLING AND TESTING**

**8.1** The sampling procedure and criteria for conformity of a lot to the requirements of this specification shall be as specified in Annex C.

### **8.2 Factory Production Control**

**8.2.1** The manufacturer shall establish and document a factory production control system consisting of procedures for the internal control of production to ensure that the final products comply with the requirements of the present standard.

**8.2.2** The manufacturer shall verify the specifications of incoming raw materials and components.

**8.2.3** The relevant features of the ball valve and production process shall be defined by giving the frequency of the inspection checks and tests, together with the criteria required for the controlling and manufacturing processes in accordance with the requirements of this standard. The factory production control system shall specify the

action to be taken when the control values or criteria specified are not met. Measuring equipment shall be verified and the procedure, frequency and criteria documented.

**8.2.4** The stock control of finished products, together with procedures for dealing with non-conforming products, shall be documented.

## **9 PACKAGING**

**9.1** After inspection and before dispatch, valves shall be thoroughly dried and cleaned,

**9.2** The painting/plating of the finished valves shall be at the option of the manufacturer, unless otherwise specified by the purchaser.

**9.3** Valves shall be prepared for dispatch in such a way as to minimize the possibility of damage to inside or outside parts during storage or in transit. Openings shall be closed by suitable means to exclude dirt and other foreign matter from the interior of the valves.

**9.4** Lever or wrench of valves above 50 mm size may be removed from the valves and packed along with the valve secured by cord or wire.

## **10 MARKING**

### **10.1 Legibility**

Each valve manufactured in accordance with this Indian Standard shall be clearly marked in accordance with IS 9866 except that the requirements of the **10.2** and **10.3** shall apply.

### **10.2 Body Marking**

**10.2.1** The mandatory valve body markings subject to the provisions shall be as follows:

- a) Manufacturer's name or trademark;
- b) Body material;
- c) Pressure rating as PN followed by the appropriate pressure number (for example, PN 16 for PN-designated valves) or pressure Class number (for example, Class 150 for Class designated valves);
- d) Nominal size, as either DN, followed by the appropriate size number (for example, DN 100).

**10.2.2** For valves smaller than DN 50, if the size or shape of the valve body precludes the inclusion of all the required markings, one or more may be omitted provided that they are shown on the name plate. The sequence of omission shall be as follows:

- a) Nominal size;
- b) PN designation or Class number;
- c) Body material.

### **10.3 Identification Plate**

**10.3.1** Each valve shall have an identification plate with the following marking:

- a) Manufacturer's name;
- b) pressure rating designation, PN or Class;
- c) Manufacturer's identification number;
- d) Maximum pressure at 38 °C;
- e) Limiting temperature and associated pressure, if applicable;
- f) Limiting differential pressure and associated temperature, if applicable;
- g) Trim identification (for example, 316SS);
- h) Seat and seal material (for example, PTFE/Graphite);
- j) Pipe thread identification, NPT, or Rc.

**10.3.2** The material of the identification plate(s) shall be austenitic stainless steel or nickel alloy. Identification plate shall be attached to the valve body by welding or by pins made from the same materials allowed for the name plate. Other methods of attachment are acceptable only by agreement with the purchaser.

**10.3.3** Any additional marking required may be as agreed to between the purchaser and the manufacturer.

### **10.4 BIS Certification Marking**

Each ball valve conforming to the requirements of this standard may be certified as per the conformity assessment schemes under the provisions of the *Bureau of Indian Standards Act*, 2016 and the Rules and Regulations framed thereunder, and the ball valve may be marked with the 'Standard Mark'.

**ANNEX A**

(Clause 2)

**LIST OF REFERRED INDIAN STANDARDS**

<i>IS No.</i>	<i>Title</i>
IS 193 : 2000	Soft solder — Specification (Fifth Revision)
IS 210 : 2009	Grey iron castings — Specification (Fifth Revision)
IS 318 : 1981	Specification for leaded tin bronze ingots and castings (Second Revision)
IS 319 : 2007	Free cutting brass bars, rods, and section — Specification (Fifth Revision)
IS 513 (Part 2) : 2016	Cold Reduced Carbon Steel Sheet and Strip Part 2 High Tensile and Multi-phase Steel ( <i>Sixth Revision</i> )
IS 554 : 1999	Pipe threads where pressure - Tight joints are made on the threads - Dimensions, tolerances and designation (Fourth Revision)
IS 1030 : 1998	Carbon steel castings for general engineering purposes - Specification (Fifth Revision)
IS 1038 : 1983	Specification for steel doors, windows and ventilators ( <i>Third Revision</i> )
IS 1239 (Part 2) : 2011	Steel tubes, tubulars and other steel fittings — Specification: Part 2 steel pipe fittings (Fifth Revision)
IS 1264 : 1997	Brass gravity die castings — Specification (Fourth Revision)
IS 1538 : 1993	Cast iron fittings for pressure pipes for water, gas and sewage — Specification (Third Revision)
IS 1570 (Part 2): 1979	Schedules for wrought steels
IS 1865 : 1991	Iron castings with spheroidal or nodular graphite — Specification (Third Revision)
IS 2062 : 2011	Hot rolled medium and high tensile structural steel — Specification (Seventh Revision)
IS 2635 : 1997	DC electric welding generators — Specification (Third Revision)
IS 2643 : 2005	Pipe threads where pressure - Tight joints are not made on the threads - Dimensions, tolerances and designation (Third Revision)
IS 2858 : 1984	Code of practice for roofing with Mangalore tiles (First Revision)
IS 6392 : 2020	Steel pipe flanges — Specification (Fifth Revision)



<i>IS No.</i>	<i>Title</i>
IS 6603 : 2001	Stainless steel bars and flats — Specification (First Revision)
IS 6912 : 2005	Copper and copper alloys forging stock and forging — Specification (Second Revision)
IS 9523 : 2000	Ductile iron fittings for pressure pipes for water, gas and sewage — Specification (First Revision)
IS 9866 : 1981	Marking system for valves

**ANNEX B**  
*(Foreword)*

**INFORMATION TO BE GIVEN BY PURCHASER**

**B-1** The following information is to be given by the purchaser in an enquiry or order:

- a) Pattern of the valve **(3.1)**;
- b) Nominal size DN **(2)**;
- c) Reduced bore or full-bore type;
- d) Nominal pressure - class designation **(3.3)**, and service temp;
- e) Flanged ends, including facing **(3.6.1)**;
- f) Screwed ends, state whether a specified thread form is required (taper or parallel) **(3.6.3)**;
- g) Gear operation, if required, including type and arrangement **(3.9)**;
- h) Power operation, if required, Including power supply and maximum design differential pressure across the valve **(3.9)**;
- j) Any preference for materials **(3.10)**; and
- k) State whether any of the following is required:
  - i) Drain connection,
  - ii) Inspection is required by buyer **(4)**,
  - iii) Test certificate and number of copies **(4.3)**, and
  - iv) Painting **(7)**
- m) Any other test as specified in **7.6**, if required, specify the requirements, and also specify if the inspection required would be done by the purchaser or his representative.

## ANNEX C

(Clauses 7.3.1.2 and 8.1)

### SAMPLING AND CRITERIA FOR CONFORMITY

#### C-1 SCALE OF SAMPLING

##### C-1.1 Lot

In any consignment, all the ball valves made of the same material of the same nominal size, of the same type and class and from the same batch of manufacture shall be grouped together to constitute a lot.

**C-1.2** For ascertaining the conformity of material in the lot to the requirements of this specification, samples shall be tested from each lot separately.

**C-1.3** The number of valves to be selected from the lot shall depend on the size of the lot and shall be according to Table 15.

**Table 15 Scales of Sampling and Criteria for Conformity**  
(Clauses C-1.3 and C-2.1.1)

SI No.	No. of Valves in the Lot	Sample Size	Acceptance Number	Sub-Sample Size
(1)	(2)	(3)	(4)	(5)
i)	Up to 150	8	0	3
ii)	151 to 300	13	0	5
iii)	301 to 500	20	1	8
iv)	501 to 1000	32	2	13
v)	1001 to 3000	50	3	20
vi)	3001 and above	80	5	32

**C-1.3.1** These valves shall be selected at random from the lot. In order to ensure the randomness of the selection, procedures given in IS 4905 may be followed.

#### C-2 NUMBER OF TESTS AND CRITERIA FOR CONFORMITY

**C-2.1** All the valves selected according to **C-1.3** shall be examined for material, design and manufacture and dimensions. Sample valves failing to satisfy one or more of these requirements shall be considered as defective.

**C-2.1.1** The lot shall be considered to have satisfied these requirements if the number of the defective valves found in the sample is less than or equal to the corresponding acceptance number given in column 4 of Table 15.

#### C-3 TEST CERTIFICATES

If specified by the purchaser, test certificate confirming that the valves have been

tested in accordance with the standard and stating the actual pressure and medium used in the tests shall be furnished by the manufacturer.